



LAKE COUNTY

FLORIDA

OFFICE OF PROCUREMENT SERVICES
315 WEST MAIN STREET, SUITE 441
PO BOX 7800
TAVARES FL 32778-7800

PHONE: (352) 343-9839
FAX: (352) 343-9473

www.lakegovernment.com

ADDENDUM NO. 2

Addendum Date: May 22, 2014
Invitation to Bid (ITB) 14-0217

REPLACEMENT OF CENTRAL ENERGY PLANT BOILERS AT THE LAKE COUNTY DETENTION CENTER

It is the vendor's responsibility to ensure their receipt of all addenda, and to clearly acknowledge all addenda within their initial bid response. Acknowledgement may be confirmed either by inclusion of a signed copy of this addendum with the initial bid response, or by completion and return of the addendum acknowledgement section of the solicitation. Failure to acknowledge each addendum may prevent the bid from being considered for award.

This addendum does NOT change the date for receipt of bids

The purpose of this addendum is to provide confirming information to all potential responding vendors in association with the cited Invitation to Bid. The information provided herein summarizes discussions at the mandatory pre-bid meeting, and provides a supplemental drawing to drawing M3. Attendees of that meeting are noted on the County website for this solicitation.

The pre-bid conference commenced with a general review of the ITB with specific emphasis paid to various specific terms and conditions of the ITB including:

- The due date and time for receipt of bids.
- The fact that the vendor would be responsible for payment of sales tax on all materials purchased by the vendor for inclusion in the project.
- The fact that this was a mandatory pre-bid conference and that bids from vendors not attending the conference could not be considered for award.
- That alternate items could be considered subject to provision of clear documentation confirming equal performance to equipment identified within the ITB.

A walk-through of the facility was then completed. The following general information is confirmed as discussed in the walk-through:

:


1. There will be a need to complete the switchover to the new equipment at a time when water use at the facility is minimal. The timeframe for this effort will be from 11:00 PM to 2:30 AM on the night of switchover.
2. Revision of certain installation effort was discussed and is described on the attached supplement to drawing M3.
3. Use of "pro press" copper fittings was approved.
4. It was confirmed that current openings for exhaust vents could be utilized with rain caps installed as required.

Acknowledgement of receipt and review of addendum:

Firm Name: _____ Date: _____

Signature: _____ Title: _____

Typed/Printed Name: _____

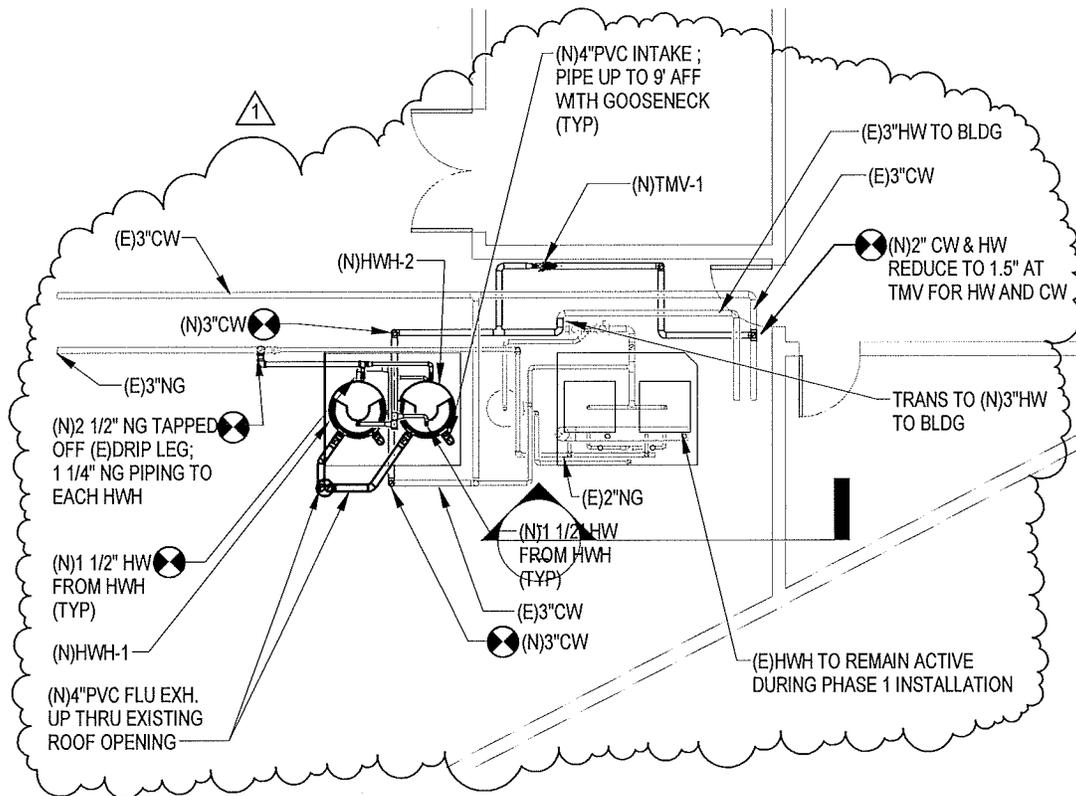

MIXING VALVE REVISIONS

SCALE: 1/8" = 1'-0"

REVISION: 1 - Addendum 1

PROJECT: LAKE COUNTY JAIL CENTRAL ENERGY PLANT DOMESTIC WATER HEATING

SUPPLEMENT TO DRAWING No.: M-3

TLC JOB No.: 513151

SCALE: 1/8" = 1'-0"

DATE: 5/21/14

DESIGN: Designer

CHECKED: Checker



874 Dixon Blvd.
Cocoa, Florida 32922
Phone: 321-636-0274
Fax: 321-639-8986
www.tlc-engineers.com

© Copyright 2013
TLC Engineering for
Architecture, Inc.

EB #000015

SKETCH No.

SKM-1